

# **Acoustical Wood Door Systems**

## **Acoustical Test Reports**

**The following is a SAMPLE copy of a complete acoustical test report for an Overly STC499723 Acoustical Wood Door System as tested by Overly Door Company.**

**PDF files of the latest acoustical test reports for all of our Acoustical Wood Door Systems offered, can be viewed and downloaded from our website at [www.overly.com](http://www.overly.com).**

**Acoustical Wood Door Systems tested models subject to change without notice. Check website for latest models available.**

# RIVERBANK ACOUSTICAL LABORATORIES

1512 BATAVIA AVENUE  
GENEVA, ILLINOIS 60134

OF  
IIT RESEARCH INSTITUTE

630/232-0104

FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

## REPORT

FOR: Overly Manufacturing Company

Sound Transmission Loss  
Test RAL™-TL97-23

ON: A Fully Operable Swinging Door  
Model STC499723

Page 1 of 3

CONDUCTED: 30 January 1997

# SAMPLE

### TEST METHOD

Unless otherwise designated, the measurements reported below were made with all facilities and procedures in explicit conformity with the ASTM Designations E90-90 and E413-87, as well as other pertinent standards. Riverbank Acoustical Laboratories has been accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) for this test procedure. A description of the measuring technique is available separately. The microphone used was a Bruel & Kjaer serial number 951371.

### DESCRIPTION OF THE SPECIMEN

The test specimen was designated by the client as a fully operable swinging door, Model STC499723. The overall dimensions of the door were nominally 914 mm (36 in.) wide by 2.13 m (84 in.) high and 44 mm (1.75 in.) thick. The specimen was placed directly in the client's adapter frame and tested in the 1.22 m (4 ft) by 2.44 m (8 ft) test opening. The adapter frame was sealed on the periphery (both sides), and both surface faces of the frame, with a dense mastic. The manufacturer's description of the specimen was as follows:

This pan was then encased on its four (4) edges by bonding wood framing members around the perimeter, and faced on both sides with 1/8" thick laminated wood face sheets. The bottom of the door was equipped with an adjustable Overly "Super H" closed cell neoprene door bottom. A 14 gauge metal frame was prepared with a single row of Overly "H" seals of felt/neoprene composition at the head and jambs. The door was hung on two 5" full mortised cam lift hinges and equipped with a fully functional heavy duty cylindrical lockset. The specimen was opened and closed at least five times, and the test was conducted with no further adjustments. A manufacturer's description is maintained on file. The weight of the door panel as measured was 88.5 kg (195 lbs) an average of 45.4 kg/m<sup>2</sup> (9.3 lbs/ft<sup>2</sup>). The transmission area used in the calculations for transmission loss was 2.0 m<sup>2</sup> (21 ft<sup>2</sup>). The source and receiving room temperatures at the time of the test were 19°C (67±2°F) and 54±2% relative humidity.

# RIVERBANK ACOUSTICAL LABORATORIES

1512 BATAVIA AVENUE  
GENEVA, ILLINOIS 60134

OF  
IIT RESEARCH INSTITUTE

630/232-0104  
FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

## REPORT

Overly Manufacturing Company

RAL™-TL97-23

30 January 1997

Page 2 of 3

### TEST RESULTS

Sound transmission loss values are tabulated at the eighteen standard frequencies. A graphic presentation of the data and additional information appear on the following pages. The precision of the TL test data are within the limits set by the ASTM Standard E90-90.

<u>FREQ.</u>	<u>T.L.</u>	<u>C.L.</u>	<u>DEF.</u>	<u>FREQ.</u>	<u>T.L.</u>	<u>C.L.</u>	<u>DEF.</u>
100	32	0.30	0	800	48	0.21	3
125	32	0.30	1	1000	51	0.20	1
160	38	0.30	0	1250	53	0.20	0
200	37	0.36	2	1600	55	0.16	0
250	41	0.34	1	2000	57	0.14	0
315	44	0.30	1	2500	57	0.13	0
400	42	0.27	6	3150	56	0.10	0
500	44	0.27	5	4000	56	0.09	0
630	46	0.23	4	5000	56	0.09	0


STC = 49

# SAMPLE


### ABBREVIATION INDEX

FREQ. = FREQUENCY, HERTZ, (cps)  
T.L. = TRANSMISSION LOSS, dB  
C.L. = UNCERTAINTY IN dB, FOR A 95% CONFIDENCE LIMIT  
DEF. = DEFICIENCIES, dB<STC CONTOUR  
STC = SOUND TRANSMISSION CLASS

Tested and  
Submitted by

  
Peter E. Straus  
Senior Experimentalist

Reviewed by

  
John W. Kopec  
Laboratory Manager

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.

ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY  
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.



THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES

# RIVERBANK ACOUSTICAL LABORATORIES

1512 BATAVIA AVENUE  
GENEVA, ILLINOIS 60134


OF  
IIT RESEARCH INSTITUTE

630/232-0104  
FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

## REPORT

### TRANSMISSION LOSS REPORT RAL-TL97-23

PAGE 3 OF 3

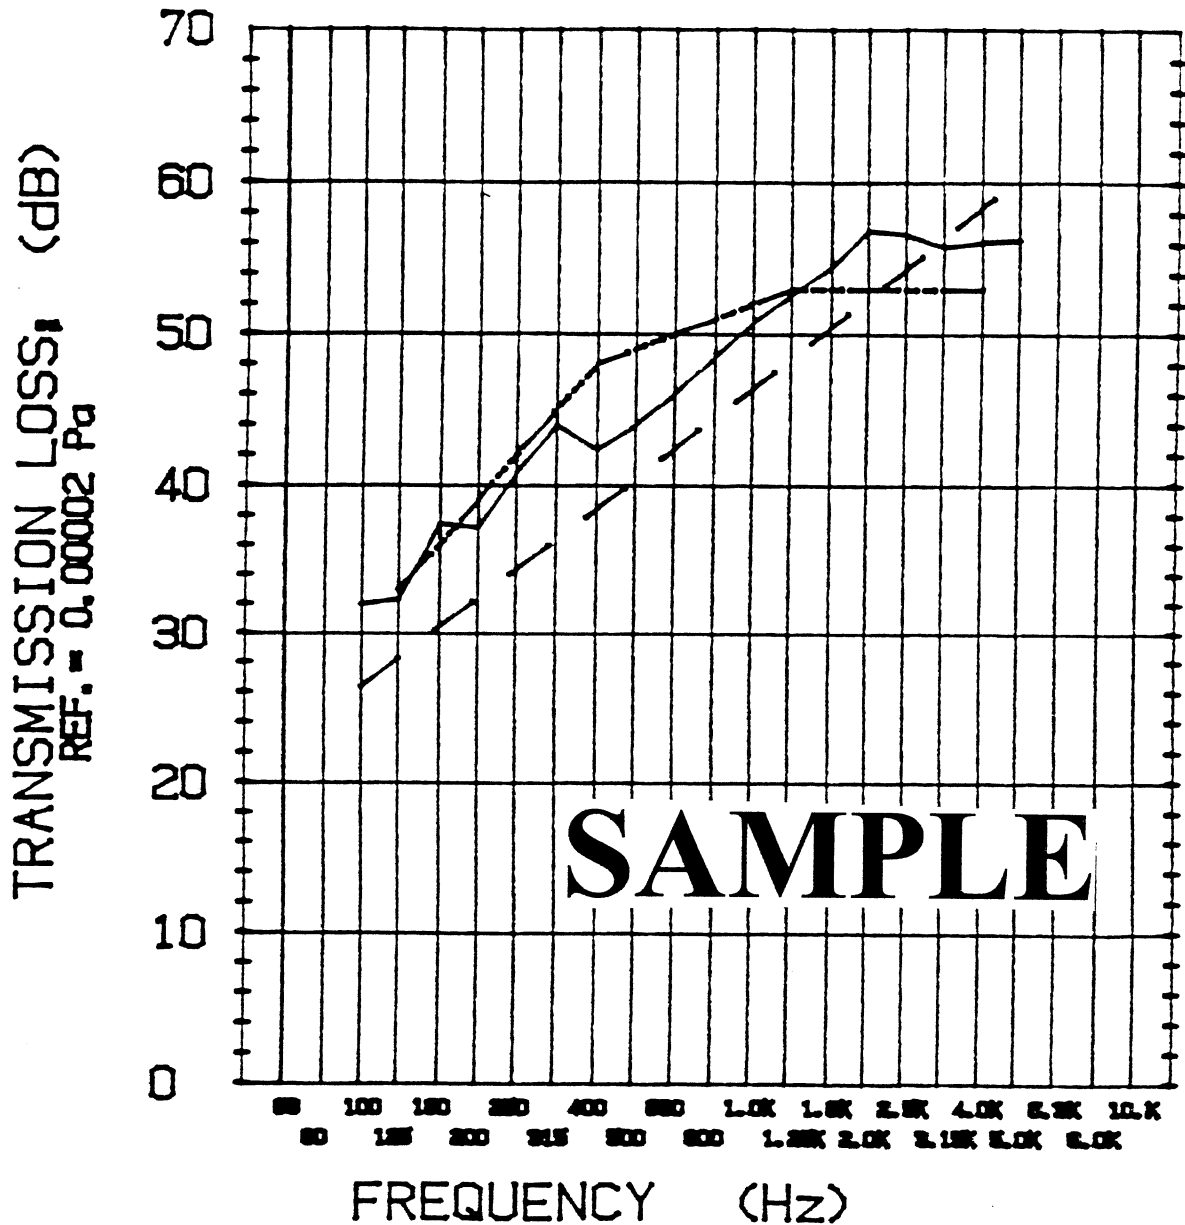

- TRANSMISSION LOSS
- - - - SOUND TRANSMISSION CLASS CONTOUR
- . - . MASS LAW CONTOUR

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY  
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.  
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES