

RIVERBANK ACOUSTICAL LABORATORIES

1512 BATAVIA AVENUE
GENEVA, ILLINOIS 60134

OF
IIT RESEARCH INSTITUTE

708/232-0104
FOUNDED 1918 BY
WALLACE CLEMENT SABINE

REPORT

FOR: Overly Manufacturing Company

Sound Transmission Loss
Test RAL™-TL92-284

ON: Fully Operable Swinging
Door Model STC4892284

Page 1 of 4

CONDUCTED: 16 September 1992

TEST METHOD

Unless otherwise designated, the measurements reported below were made with all facilities and procedures in explicit conformity with the ASTM Designations E90-90 and E413-87, as well as other pertinent standards. Riverbank Acoustical Laboratories has been accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) for this test procedure. A description of the measuring technique is available separately. The microphone used was a Bruel & Kjaer serial number 1330658.

DESCRIPTION OF THE SPECIMEN

The test specimen was designated by the manufacturer as a fully operable swinging door, Model STC4892284. The overall dimensions of the door panel were nominally 914 mm (36 in.) wide by 2.13 m (84 in.) high and 48 mm (1.875 in.) thick. The specimen was placed directly in the client's adapter frame and tested in the 1.22 m (4 ft) by 2.44 m (8 ft) test opening. The adapter frame was sealed on the periphery (both sides) with a dense mastic. The manufacturer's description of the specimen was as follows:

The bottom of the door had a fixed felt seal and an adjustable "Super H" closed cell neoprene seal. The 14 gauge metal frame was equipped with single "H" seals of felt/neoprene composition at the head and jambs. The frame also had 4.7 mm (0.187 in.) steel hinge reinforcements with mud boxes.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

RIVERBANK ACOUSTICAL LABORATORIES

1512 BATAVIA AVENUE
GENEVA, ILLINOIS 60134

OF
IIT RESEARCH INSTITUTE

708/232-0104
FOUNDED 1918 BY
WALLACE CLEMENT SABINE

REPORT

Overly Manufacturing Company

RAL™-TL92-284

16 September 1992

Page 2 of 4

DESCRIPTION OF THE SPECIMEN (con't)

The door was hung on two 127 mm (5.0 in.) full mortise cam-lift hinges and was equipped with a functional heavy duty cylindrical lockset. A manufacturer's description and detailed drawing file number 0667, page 7 of 13 are maintained on file. At the request of the manufacturer the details of the construction were purposely withheld from this report in order that the manufacturer may control full proprietary rights regarding the product. The weight of the door panel as determined was 95.3 kg (210 lbs) an average of 48.9 kg/m² (10.0 lbs/ft²). The transmission area used in the calculations was 1.95 m² (21 ft²). The specimen was opened and closed at least five times, and the test was conducted with no further adjustments. The source and receiving room temperatures at the time of the test were 24°C (75±2°F) and 60±2% relative humidity.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

RIVERBANK ACOUSTICAL LABORATORIES

1512 BATAVIA AVENUE
GENEVA, ILLINOIS 60134

OF
IIT RESEARCH INSTITUTE

708/232-0104
FOUNDED 1918 BY
WALLACE CLEMENT SABINE

REPORT

Overly Manufacturing Company

RAL™-TL92-284

16 September 1992

Page 3 of 4

TEST RESULTS

Sound transmission loss values are tabulated at the eighteen standard frequencies. A graphic presentation of the data and additional information appear on the following pages. The precision of the TL test data are within the limits set by the ASTM Standard E90-90.


<u>FREQ.</u>	<u>T.L.</u>	<u>C.L.</u>	<u>DEF.</u>	<u>FREQ.</u>	<u>T.L.</u>	<u>C.L.</u>	<u>DEF.</u>
100	29	0.25	0	800	48	0.28	2
125	29	0.36	3	1000	49	0.26	2
160	37	0.31	0	1250	52	0.27	0
200	35	0.35	3	1600	55	0.17	0
250	39	0.41	2	2000	58	0.20	0
315	39	0.41	5	2500	61	0.15	0
400	41	0.40	6	3150	61	0.14	0
500	44	0.35	4	4000	62	0.10	0
630	47	0.36	2	5000	62	0.10	0

STC = 48


ABBREVIATION INDEX

FREQ. = FREQUENCY, HERTZ, (cps)
T.L. = TRANSMISSION LOSS, dB
C.L. = UNCERTAINTY IN dB, FOR A 95% CONFIDENCE LIMIT
DEF. = DEFICIENCIES, dB<STC CONTOUR
STC = SOUND TRANSMISSION CLASS

Submitted by


Peter E. Straus
Experimentalist

Reviewed by


John W. Kopec
Supervisor, Riverbank
Acoustical Laboratories

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

RIVERBANK ACOUSTICAL LABORATORIES

1512 BATAVIA AVENUE
GENEVA, ILLINOIS 60134

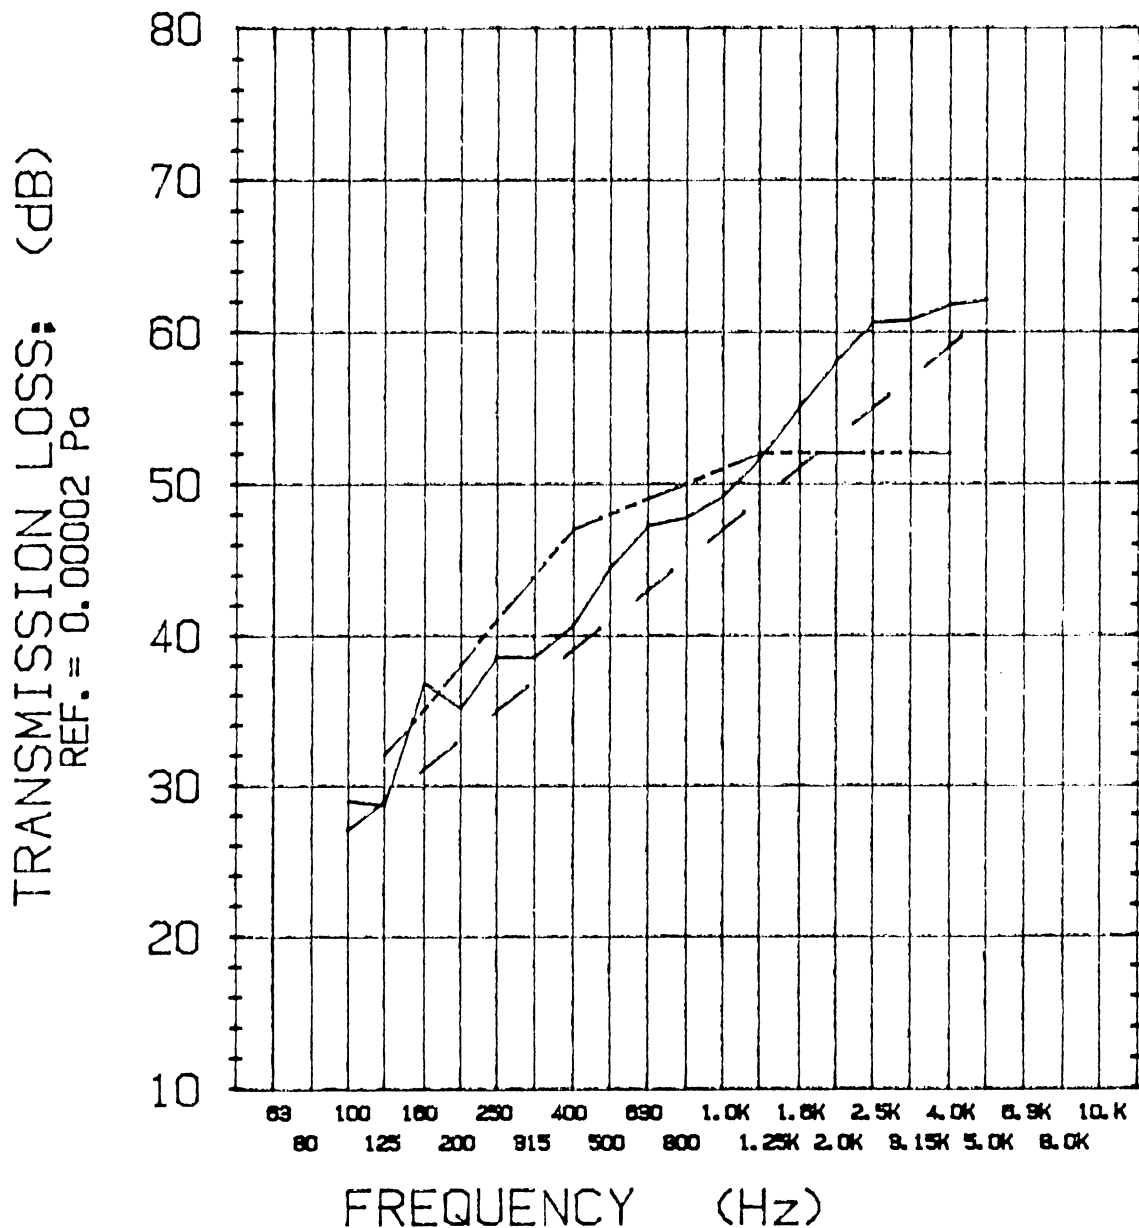
OF
IIT RESEARCH INSTITUTE

708/232-0104
FOUNDED 1918 BY
WALLACE CLEMENT SABINE

REPORT

TRANSMISSION LOSS REPORT

RAL-TL92-284 Page 4 of 4



—— TRANSMISSION LOSS
----- SOUND TRANSMISSION CLASS CONTOUR
- - - MASS LAW CONTOUR

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.

NVLAQ

ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.