

RIVERBANK ACOUSTICAL LABORATORIES

1512 BATAVIA AVENUE
GENEVA, ILLINOIS 60134

OF
IIT RESEARCH INSTITUTE

312/232-0104
FOUNDED 1918 BY
WALLACE CLEMENT SABINE

REPORT

FOR: Overly Manufacturing Company

Sound Transmission Loss
Test RAL™-TL88-127

ON: Fully Operable Swinging
Door Model STC5388127

Page 1 of 4

CONDUCTED: 11 May 1988

TEST METHOD

Unless otherwise designated, the measurements reported below were made with all facilities and procedures in explicit conformity with the ASTM Designations E90-85 and E413-73 (Reapproved 1980), as well as other pertinent standards. Riverbank Acoustical Laboratories has been accredited by the U.S. Department of Commerce, National Bureau of Standards under the National Voluntary Laboratory Accreditation Program (NVLAP) for this test procedure. A description of the measuring technique is available separately. The serial number of the measuring microphone was 792729.

DESCRIPTION OF THE SPECIMEN

The test specimen was designated by the manufacturer as Model STC5388127 which consisted of a metal frame and fully operable swinging door with a reflective panel applied to the interior face of the door. The overall dimensions of the door as measured were 90.2 cm (35.5 in.) wide by 2.12 m (83.63 in.) high and 4.4 cm (1.75 in.) thick. The reflective panel was 86.4 cm (34.0 in.) wide by 2.07 m (81.37 in.) high and 2.7 cm (1.06 in.) thick. The specimen was placed directly in an adapter frame and tested in the 1.22 m (4 ft) by 2.44 m (8 ft) test opening. The adapter frame was sealed on both sides with a dense mastic. The manufacturer's description of the specimen was as follows:

The bottom of the door had a fixed felt seal and an adjustable "Super H" closed cell neoprene seal. The 14 gauge metal frame was equipped with double "H" seals of felt/neoprene composition at the head and jambs. The frame also had 4.75 mm (0.187 in.) steel hinge reinforcements w/mud boxes. The door was hung on two 12.7 cm (5.0 in.) full mortise cam lift hinges and was equipped with a functional heavy duty cylindrical lockset. A visual inspection verified the manufacturer's description of the specimen. A manufacturer's description and detailed drawing file number 0236, page 1 of 5 are maintained on file. At the request of the manufacturer the details of the construction were purposely withheld from this report in order that the manufacturer may control full proprietary rights regarding the product.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.

RIVERBANK ACOUSTICAL LABORATORIES

1512 BATAVIA AVENUE
GENEVA, ILLINOIS 60134

OF
IIT RESEARCH INSTITUTE

312/232-0104
FOUNDED 1918 BY
WALLACE CLEMENT SABINE

REPORT

Overly Manufacturing Company

RAL™-TL88-127

11 May 1988

Page 2 of 4

DESCRIPTION OF THE SPECIMEN (con't)

A full inspection was not performed in order to preserve the condition of the test specimen. The door with the reflective panel weighed 161 kg (355 lbs) an average of 82.6 kg/m² (16.9 lbs/ft²). The transmission area used in the calculations was 1.95 m² (21 ft²). The open area was 86.4 cm (34 in.) wide by 2.11 m (83 in.) high. The specimen was opened and closed at least five times, and the test was conducted with no further adjustments. The source and receiving room temperatures at the time of the test were 20°C (68°F) and 47% relative humidity.

TEST RESULTS

Sound transmission loss values are tabulated at the eighteen standard frequencies. A graphic presentation of the data and additional information appear on the following pages. The precision of the TL test data are within the limits set by the ASTM Standard E90-85.

<u>FREQ</u>	<u>T.L.</u>	<u>C.L.</u>	<u>DEF.</u>	<u>FREQ</u>	<u>T.L.</u>	<u>C.L.</u>	<u>DEF.</u>
100	29	0.32	0	800	52	0.27	3
125	30	0.40	7	1000	53	0.28	3
160	37	0.30	3	1250	54	0.20	3
200	41	0.41	2	1600	58	0.24	0
250	43	0.45	3	2000	63	0.20	0
315	46	0.42	3	2500	64	0.16	0
400	50	0.40	2	3150	64	0.13	0
500	53	0.37	0	4000	64	0.10	0
630	52	0.39	2	5000	67	0.08	0

STC = 53

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.

RIVERBANK ACOUSTICAL LABORATORIES

1512 BATAVIA AVENUE
GENEVA, ILLINOIS 60134

OF
IIT RESEARCH INSTITUTE

312/232-0104
FOUNDED 1918 BY
WALLACE CLEMENT SABINE

REPORT

Overly Manufacturing Company

RAL™-TL88-127

11 May 1988

Page 3 of 4


ABBREVIATION INDEX

FREQ. = FREQUENCY, HERTZ, (cps)
T.L. = TRANSMISSION LOSS, dB
C.L. = UNCERTAINTY IN dB, FOR A 95% CONFIDENCE LIMIT
DEF. = DEFICIENCIES, dB<STC CONTOUR
STC = SOUND TRANSMISSION CLASS

Submitted by


Peter E. Straus
Senior Technician

Reviewed by


Diane C. Perrone
Senior Technician

Revised 5/26/88

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.

RIVERBANK ACOUSTICAL LABORATORIES

1512 BATAVIA AVENUE
GENEVA, ILLINOIS 60134


OF
IIT RESEARCH INSTITUTE

312/232-0104
FOUNDED 1918 BY
WALLACE CLEMENT SABINE

REPORT

TRANSMISSION LOSS REPORT

RAL-TL88-127 Page 4 of 4

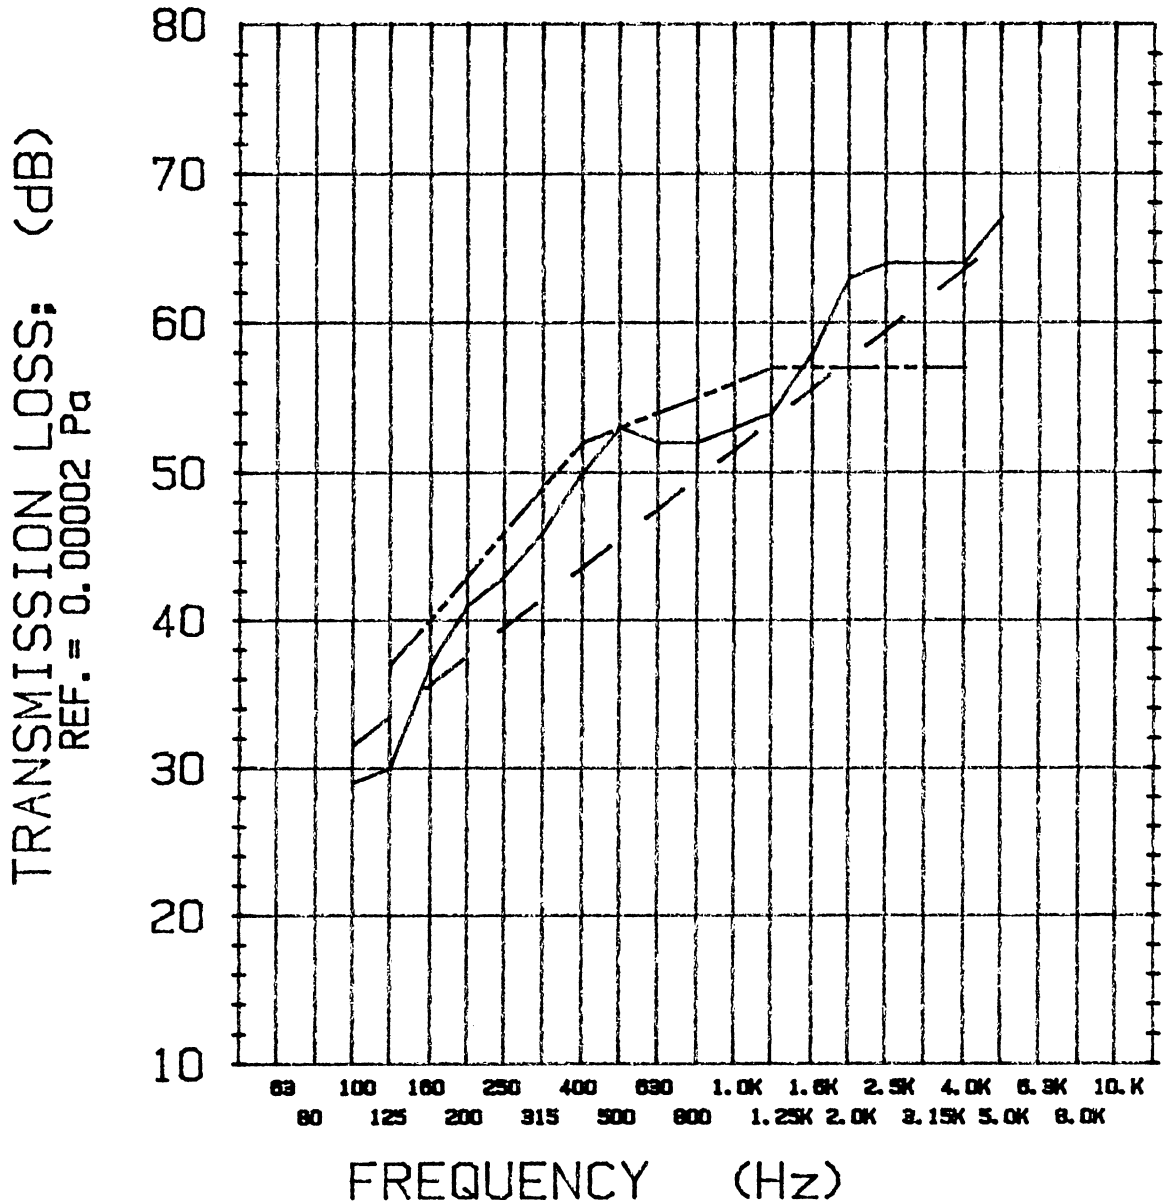

- TRANSMISSION LOSS
- SOUND TRANSMISSION CLASS CONTOUR
- - - MASS LAW CONTOUR

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.