

RIVERBANK ACOUSTICAL LABORATORIES

1512 BATAVIA AVENUE
GENEVA, ILLINOIS 60134

OF
IIT RESEARCH INSTITUTE

708/232-0104
FOUNDED 1918 BY
WALLACE CLEMENT SABINE

REPORT

FOR: Overly Manufacturing Company

Sound Transmission Loss
Test RAL™-TL92-185

ON: Fully Operable Swinging
Door Model STC5292185

Page 1 of 4

CONDUCTED: 20 May 1992

TEST METHOD

Unless otherwise designated, the measurements reported below were made with all facilities and procedures in explicit conformity with the ASTM Designations E90-90 and E413-87, as well as other pertinent standards. Riverbank Acoustical Laboratories has been accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) for this test procedure. A description of the measuring technique is available separately. The microphone used was a Bruel & Kjaer serial number 792729.

DESCRIPTION OF THE SPECIMEN

The test specimen was designated by the manufacturer as a fully operable swinging door, Model STC5292185. The overall dimensions of the door panel were nominally 914 mm (36 in.) wide by 2.13 m (84 in.) high and 48 mm (1.875 in.) thick. The specimen was placed directly in the client's adapter frame and tested in the 1.22 m (4 ft) by 2.44 m (8 ft) test opening. The adapter frame was sealed on the periphery (both sides) with a dense mastic. The manufacturer's description of the specimen was as follows:

The bottom of the door had a fixed felt seal and an adjustable "Super H" closed cell neoprene seal. The 14 gauge metal frame was equipped with single "H" seals of felt/neoprene composition at the head and jambs. The frame also had 4.7 mm (0.187 in.) steel hinge reinforcements with mud boxes.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

RIVERBANK ACOUSTICAL LABORATORIES

1512 BATAVIA AVENUE
GENEVA, ILLINOIS 60134

OF
IIT RESEARCH INSTITUTE

708/232-0104
FOUNDED 1918 BY
WALLACE CLEMENT SABINE

REPORT

Overly Manufacturing Company

RAL™-TL92-185

20 May 1992

Page 2 of 4

DESCRIPTION OF THE SPECIMEN (con't)

The door was hung on two 127 mm (5.0 in.) full mortise cam-lift hinges and was equipped with a functional heavy duty cylindrical lockset. A visual inspection verified the manufacturer's description of the specimen. A manufacturer's description and detailed drawing file number 0644, page 8 of 11 are maintained on file. At the request of the manufacturer the details of the construction were purposely withheld from this report in order that the manufacturer may control full proprietary rights regarding the product. A full inspection was not performed in order to preserve the condition of the test specimen. The weight of the door panel as determined was 106.6 kg (235 lbs) an average of 54.6 kg/m² (11.2 lbs/ft²). The transmission area used in the calculations was 1.95 m² (21 ft²). The specimen was opened and closed at least five times, and the test was conducted with no further adjustments. The source and receiving room temperatures at the time of the test were 24°C (76±2°F) and 60±2% relative humidity.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

RIVERBANK ACOUSTICAL LABORATORIES

1512 BATAVIA AVENUE
GENEVA, ILLINOIS 60134

OF
IIT RESEARCH INSTITUTE

708/232-0104
FOUNDED 1918 BY
WALLACE CLEMENT SABINE

REPORT

Overly Manufacturing Company

RAL™-TL92-185

20 May 1992

Page 3 of 4

TEST RESULTS

Sound transmission loss values are tabulated at the eighteen standard frequencies. A graphic presentation of the data and additional information appear on the following pages. The precision of the TL test data are within the limits set by the ASTM Standard E90-90.

<u>FREQ.</u>	<u>T.L.</u>	<u>C.L.</u>	<u>DEF.</u>	<u>FREQ.</u>	<u>T.L.</u>	<u>C.L.</u>	<u>DEF.</u>
100	34	0.21	0	800	51	0.26	3
125	37	0.30	0	1000	51	0.26	4
160	41	0.34	0	1250	53	0.21	3
200	41	0.38	1	1600	56	0.22	0
250	43	0.32	2	2000	58	0.19	0
315	43	0.36	5	2500	60	0.14	0
400	45	0.33	6	3150	59	0.14	0
500	50	0.30	2	4000	60	0.10	0
630	52	0.29	1	5000	61	0.08	0

STC - 52

ABBREVIATION INDEX

- FREQ. - FREQUENCY, HERTZ, (cps)
- T.L. - TRANSMISSION LOSS, dB
- C.L. - UNCERTAINTY IN dB, FOR A 95% CONFIDENCE LIMIT
- DEF. - DEFICIENCIES, dB<STC CONTOUR
- STC - SOUND TRANSMISSION CLASS

Tested and
Reviewed by Diane C. Perrone
Diane C. Perrone
Assistant Engineer

Submitted by John W. Kopec
John W. Kopec
Supervisor, Riverbank
Acoustical Laboratories

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

RIVERBANK ACOUSTICAL LABORATORIES

1512 BATAVIA AVENUE
GENEVA, ILLINOIS 60134


OF
IIT RESEARCH INSTITUTE

708/232-0104
FOUNDED 1918 BY
WALLACE CLEMENT SABINE

REPORT

TRANSMISSION LOSS REPORT

RAL-TL92-185 Page 4 of 4

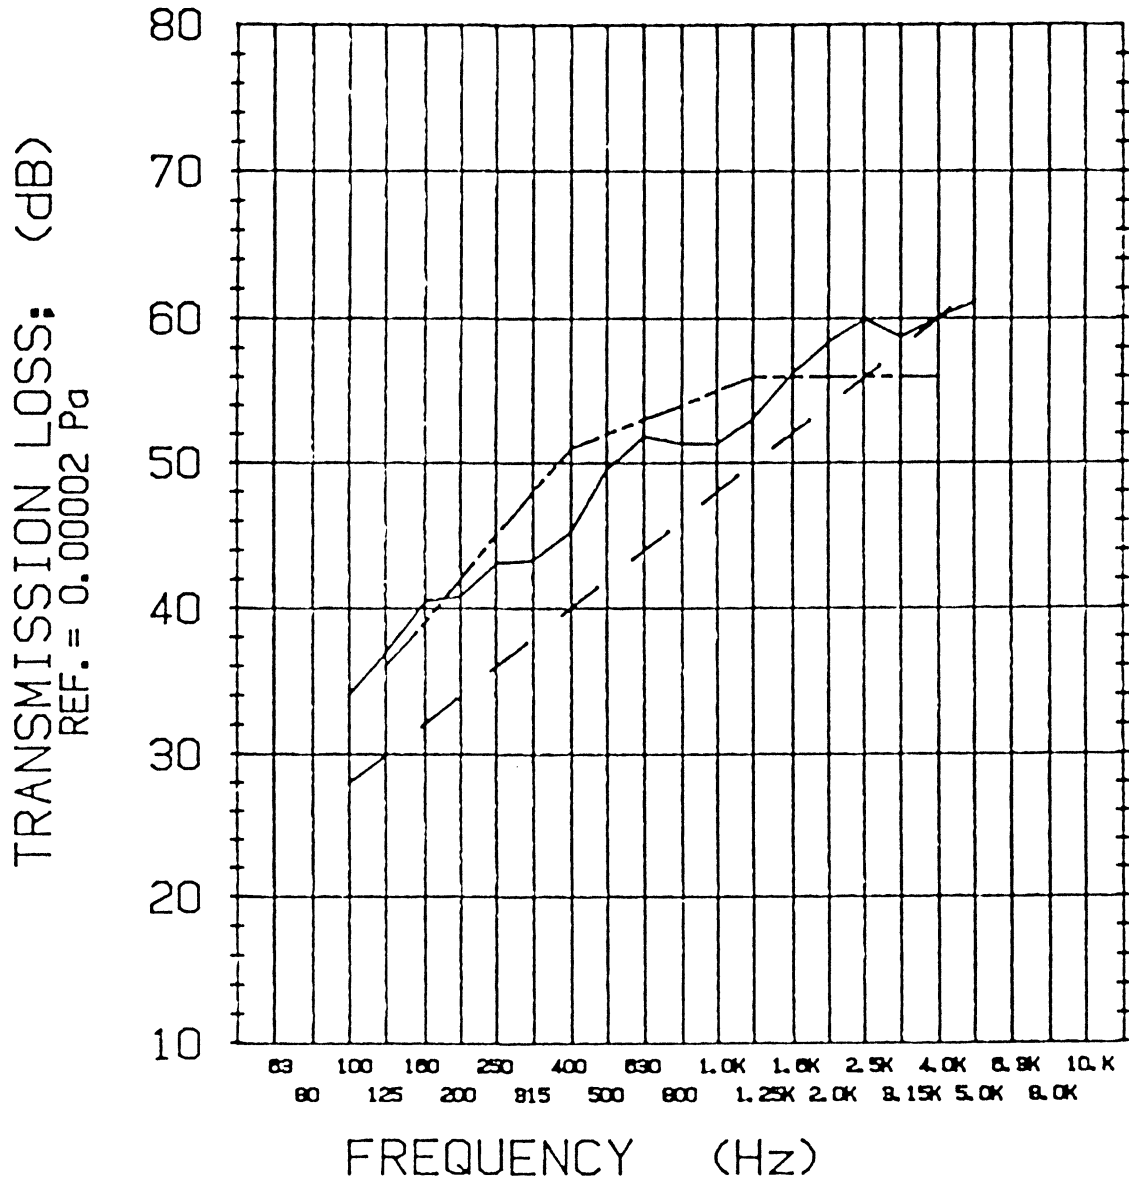

- TRANSMISSION LOSS
- - - SOUND TRANSMISSION CLASS CONTOUR
- . - MASS LAW CONTOUR

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.